



Örtliche Installationsvorschriften beachten!  
Bauseitige Verdrahtung durch einen autorisierten  
Elektrofachbetrieb ausführen lassen.  
Observe the local installation regulations.  
The on-site wiring must be laid by a certified  
and suitably qualified electrician.  
Observer les prescriptions d'installation en vigueur!  
Ne confier les opérations de câblage et de connexion  
qu'à un électricien agréé.  
Lokale installatievoorschriften opvolgen!  
Bedrading aan gebouwszijde door een bevoegd  
installatiebedrijf laten uitvoeren.




Weiterführende Informationen:  
siehe Planungshandbuch und Inbetriebnahmeanleitung  
Additional information:  
See planning manual and commissioning instructions  
Informations complémentaires:  
voir manuel de conception et guide de démarrage  
Verdere gegevens:  
zie planningshandboek en handleiding voor inbedrijfname

Detail B


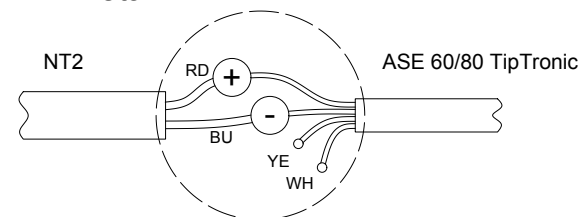


| ASE 60/80 TipTronic |    |           |
|---------------------|----|-----------|
| 1                   | RD | +28 V     |
| 2                   | BU | 0 V / GND |
| 3                   | YE | BUS-A     |
| 4                   | WH | BUS-B     |
| 5                   | BN | <  >      |
| 6                   | GN | >  <      |

Detail A

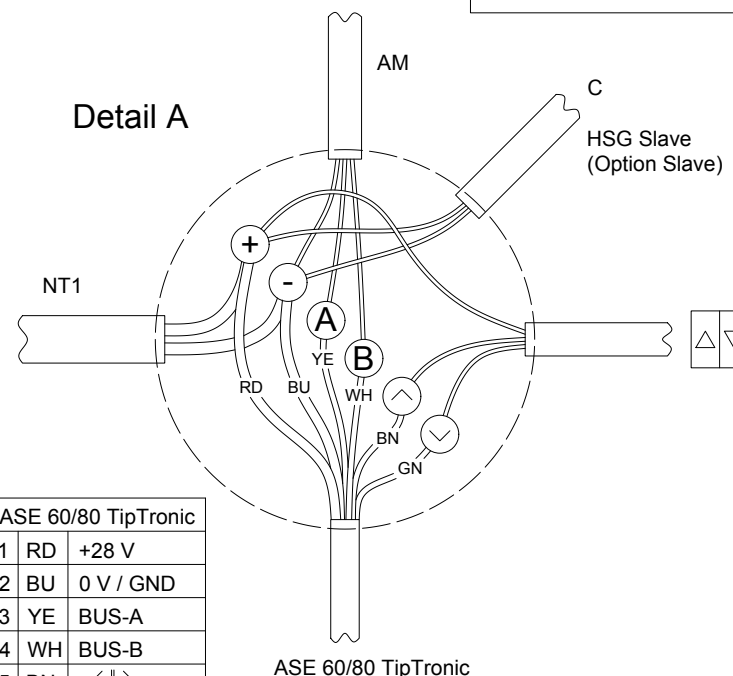


BSC (Option)

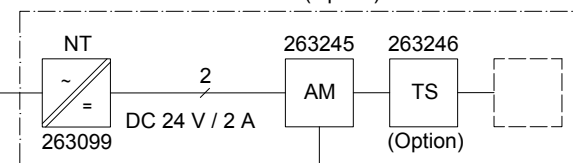


BSC  
Systemhandbuch  
System handbook  
Manuel système  
Systeemhandboek

|    |                                                                                       |     |                                                                                                      |
|----|---------------------------------------------------------------------------------------|-----|------------------------------------------------------------------------------------------------------|
| AM | Automation Manager<br>Automation Manager<br>Automations Manager<br>Automation Manager | TS  | Tasterschnittstelle<br>Button interface<br>Interface interrupteur<br>Knopinterface                   |
| NT | Netzteil<br>Power pack<br>Bloc d'alimentation<br>Voedingseenheid                      | HSG | Hauptsteuergerät<br>Main control unit<br>Appareil principal de<br>commande<br>Hoofdbesturingseenheid |

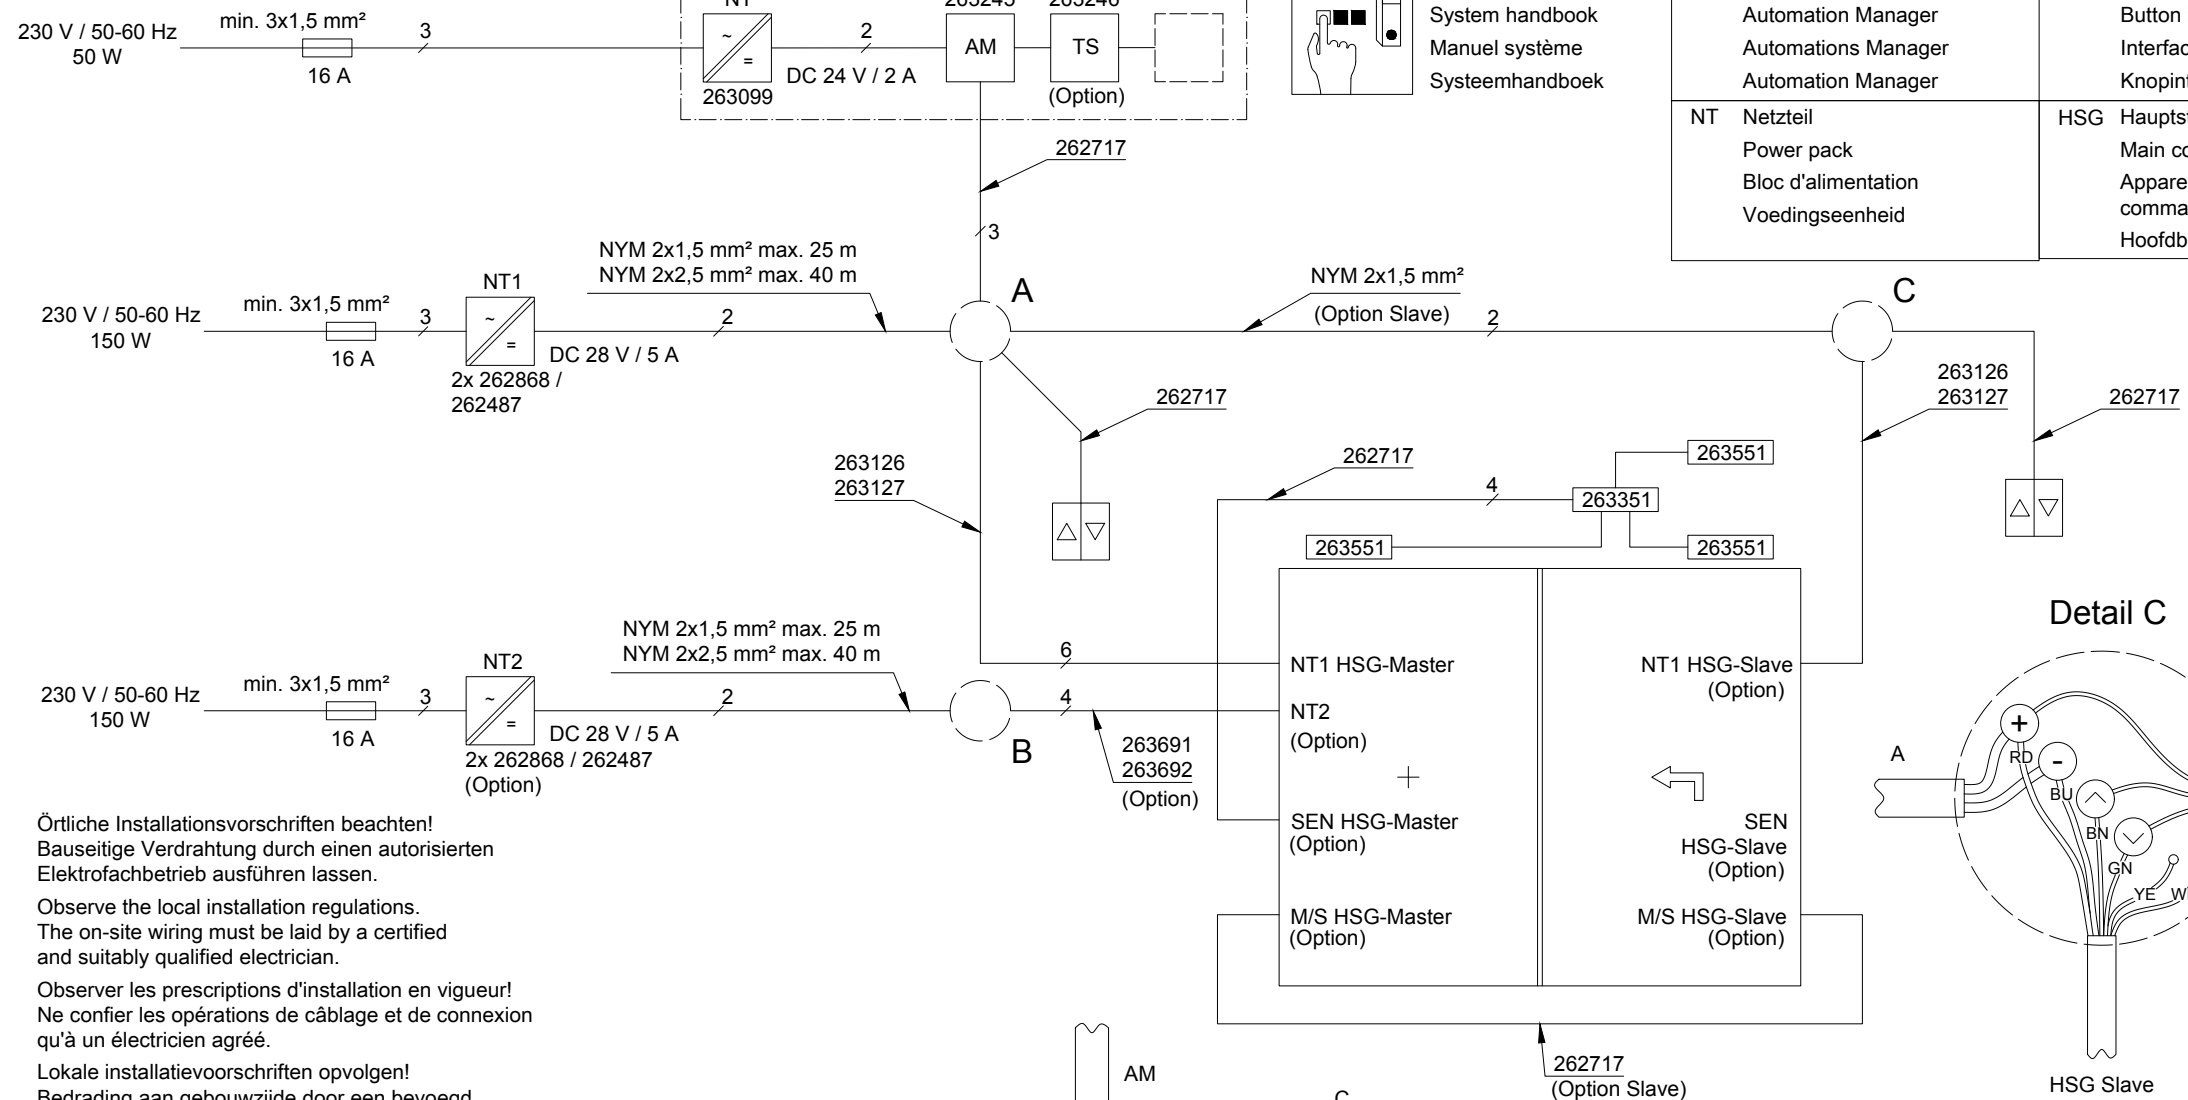

Detail C

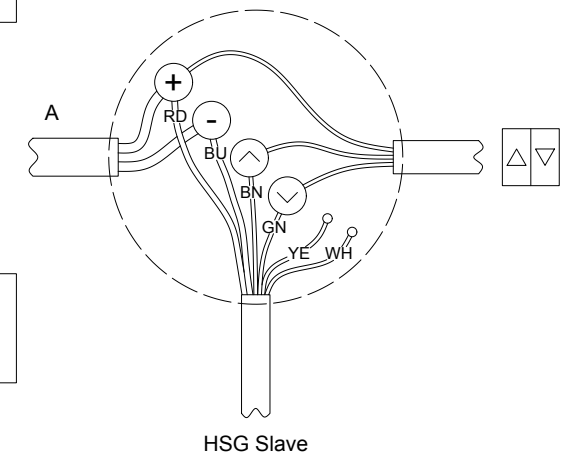

|  |                                                                                                                                                  |
|--|--------------------------------------------------------------------------------------------------------------------------------------------------|
|  | Bauseitige Abzweigdosedose<br>Junction box on site<br>Boîte de dérivation non fournie<br>Aftakdoos op bouwplaats                                 |
|  | Bauseitiger Wandtaster (Option)<br>Wall-mounted switch (option)<br>Interrupteur mural non fourni (en option)<br>Wandsensor op bouwplaats (optie) |

|                                                           |                                    |
|-----------------------------------------------------------|------------------------------------|
| Elektrische Komponenten - Installation Elektrokabel       | K1019798                           |
| Electrical components - Electric cable installation       | 0403                               |
| Composants électriques - Installation du câble électrique | Schüco<br>ASE 60 / 80<br>TipTronic |
| Elektrische componenten - Installatie elektrokabel        |                                    |